
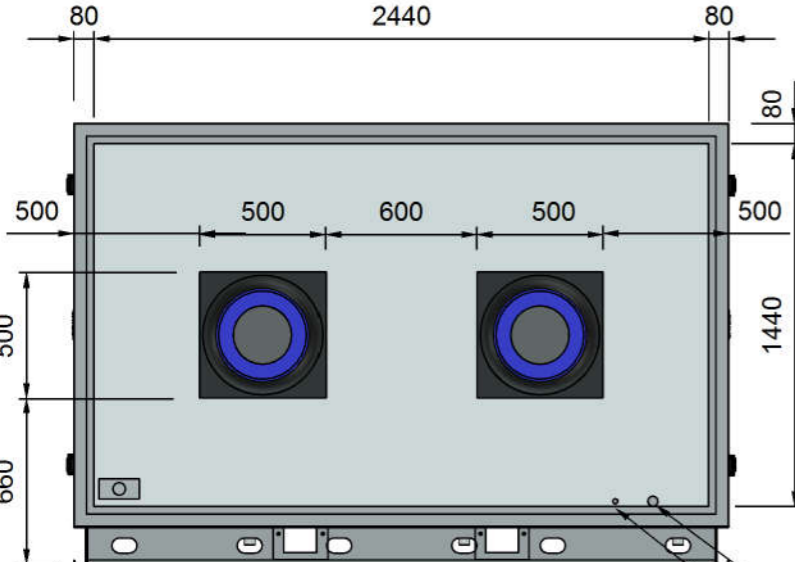



PLAN VIEW

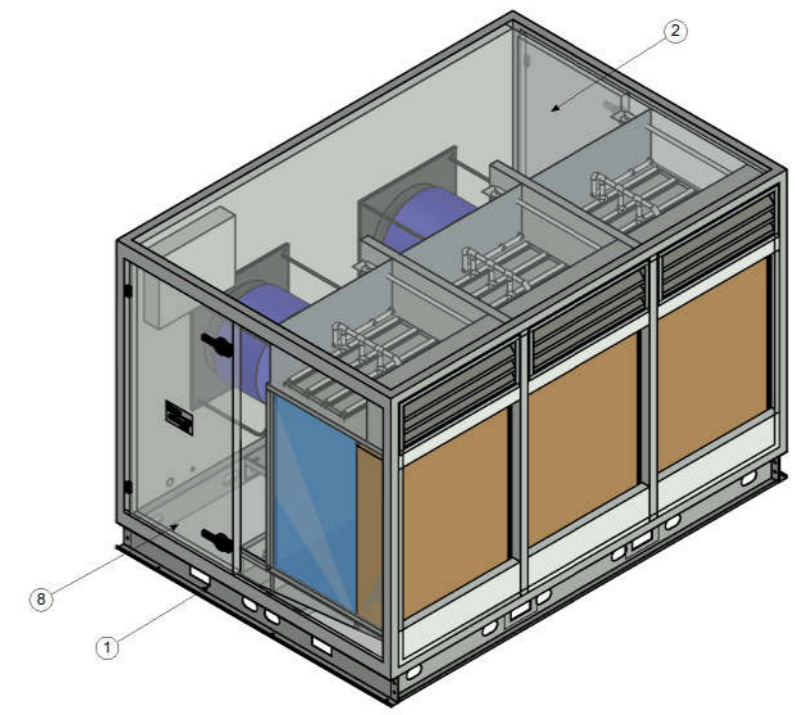

F / A SPIGOT

OVERFLOW POINT
25mm PVC
WATER INLET


FRESH AIR
INTAKE
MUST BE
FILTERED

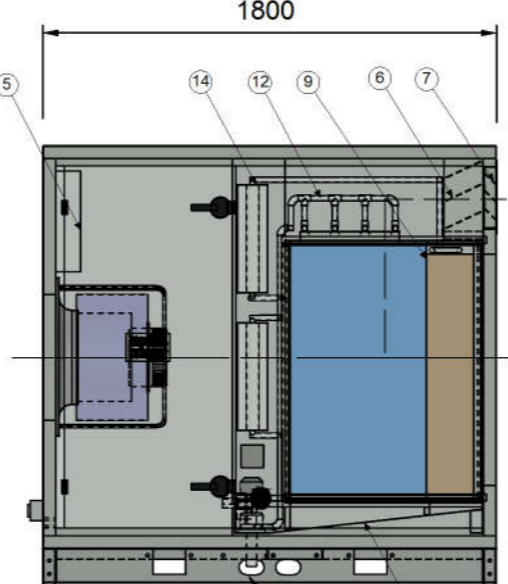

ELEVATION

EXHAUST AIR

SUPPLY AIR

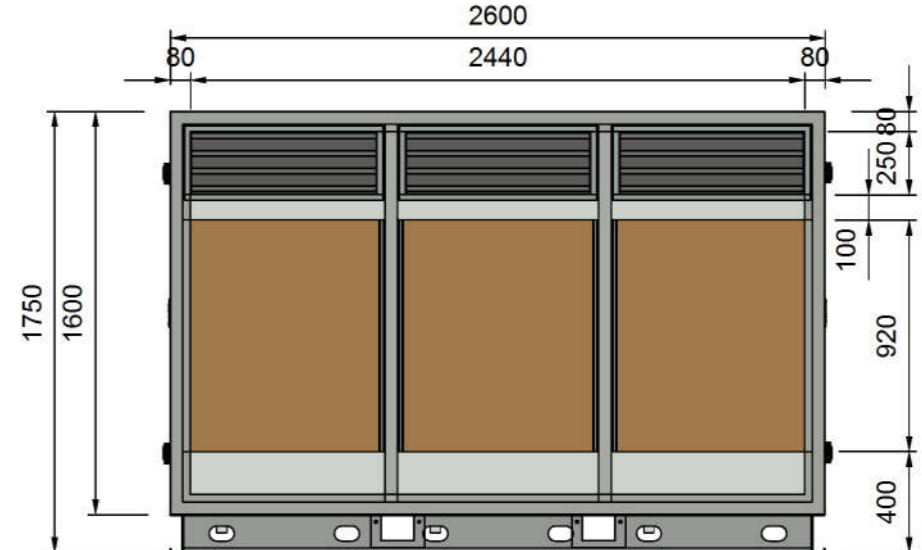

S / A SPIGOT

Item	Description	Qty
1	Base Frame	1
2	Cabinet	1
3	ECF (K)3D500-PLHDAL4	2
4	Electrical Isolator	1
5	Electrical Panel 400x500	1
6	Exhaust Air Damper	3
7	Exhaust Air Louvre Grille	3
8	Fan Access Panel 1440x680 (Pre-fabricated)	2
9	IDEC Exchanger Module 792 wide	3
10	Overflow Valve	3
11	Sump Dump	3
12	Water Dispenser Pipework	3
13	Water Fill Valve	3
14	Water Filter	6
15	Water Pump	3
16	Water Tank S/S	3

ENG NOTES:
 - All Panels are 50mm Colorbond Panel Casing
 - Minimum 1200mm Clearance Required from Access Panel
 - Intake Air Must be Filtered

	Scale	General Tolerances acc to :	Project.		
	A3	ISO 2768-1 medium	STANDARD DRAWING		
	Armcor Air Solutions 109-111 Northcorp Blvd Broadmeadows VIC 3047 Phone 03 8301 9200 Web: www.armcor.com.au Email: sales@armcor.com.au		Drawn. P.Z	Status.	Date. 30/10/2017 4:19 PM
			Title. INDIRECT COOLING UNIT	Sheet 1 of 15	Rev. A
		Model. INDEC 4500P3	SN.		